




CABLE DUCT TYPE " C " 1200 X 1000

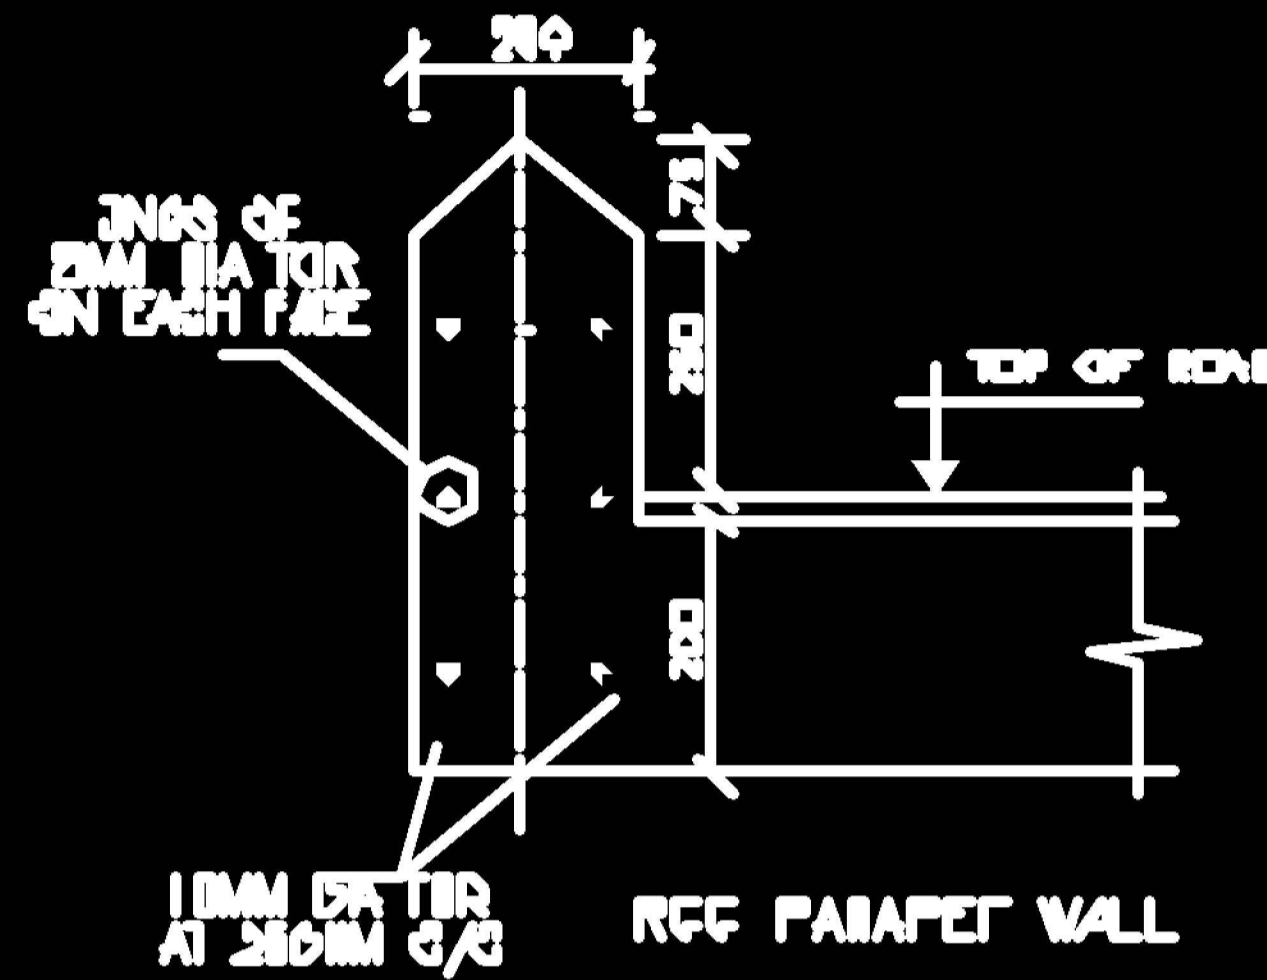


DETAIL AT B

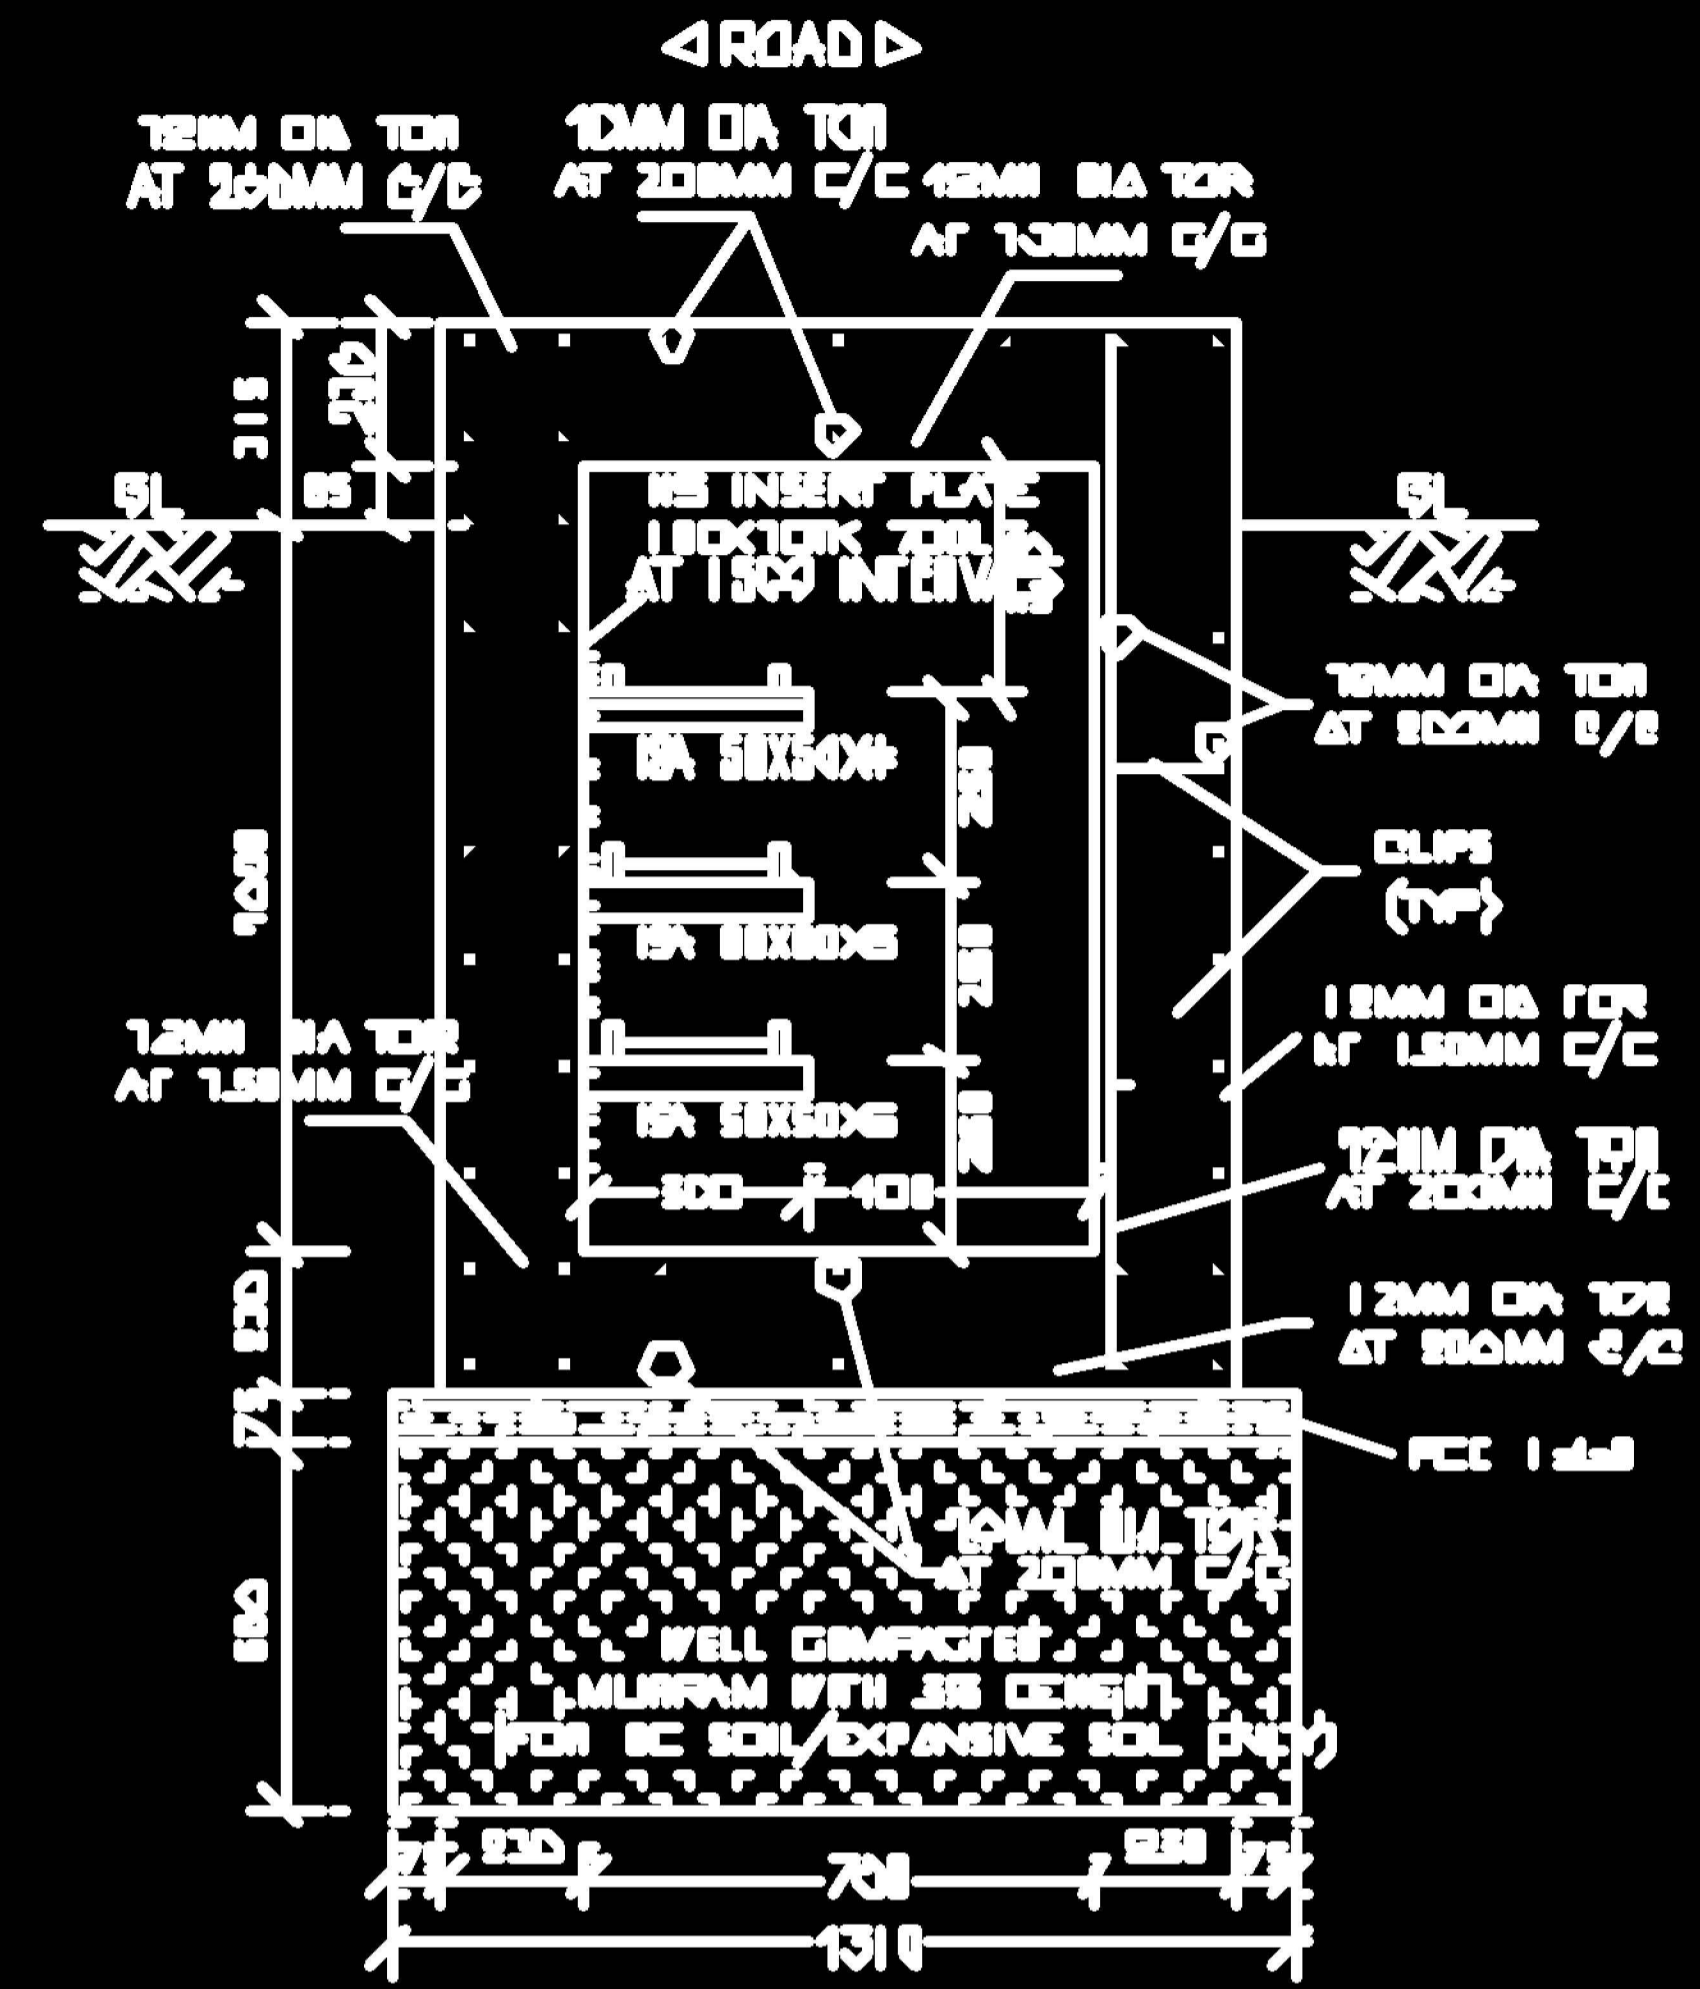

CABLE DUCT TYPE " D " 700 X 1085

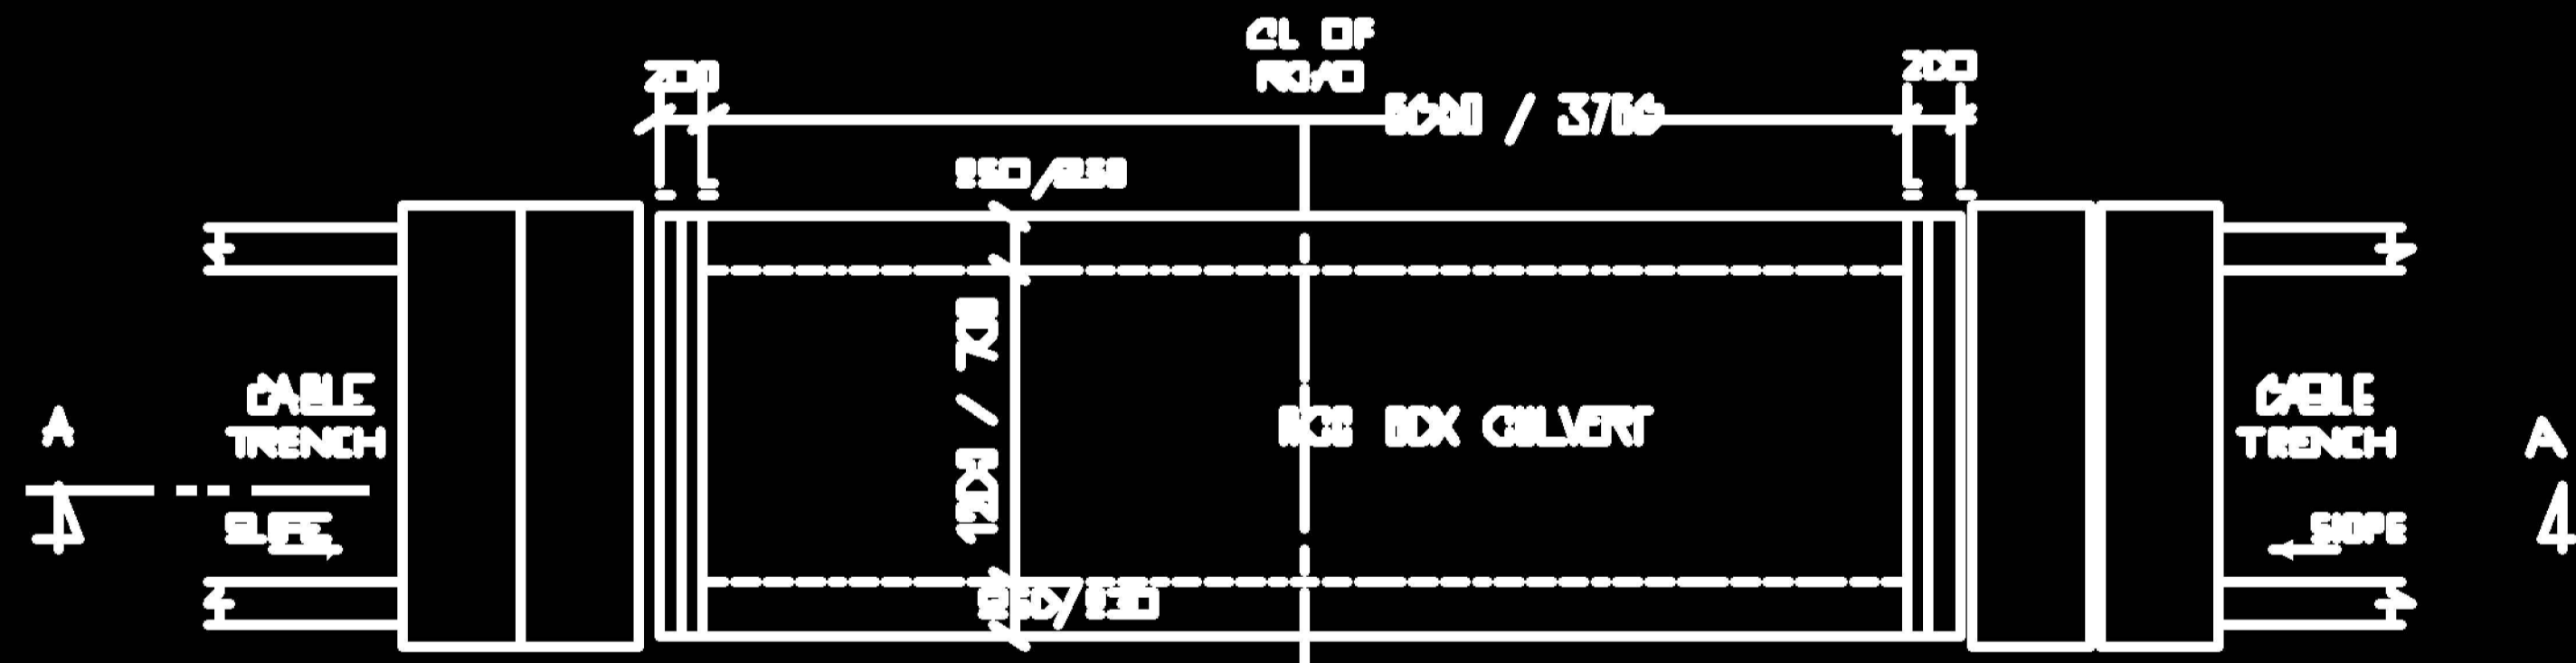

PLAN

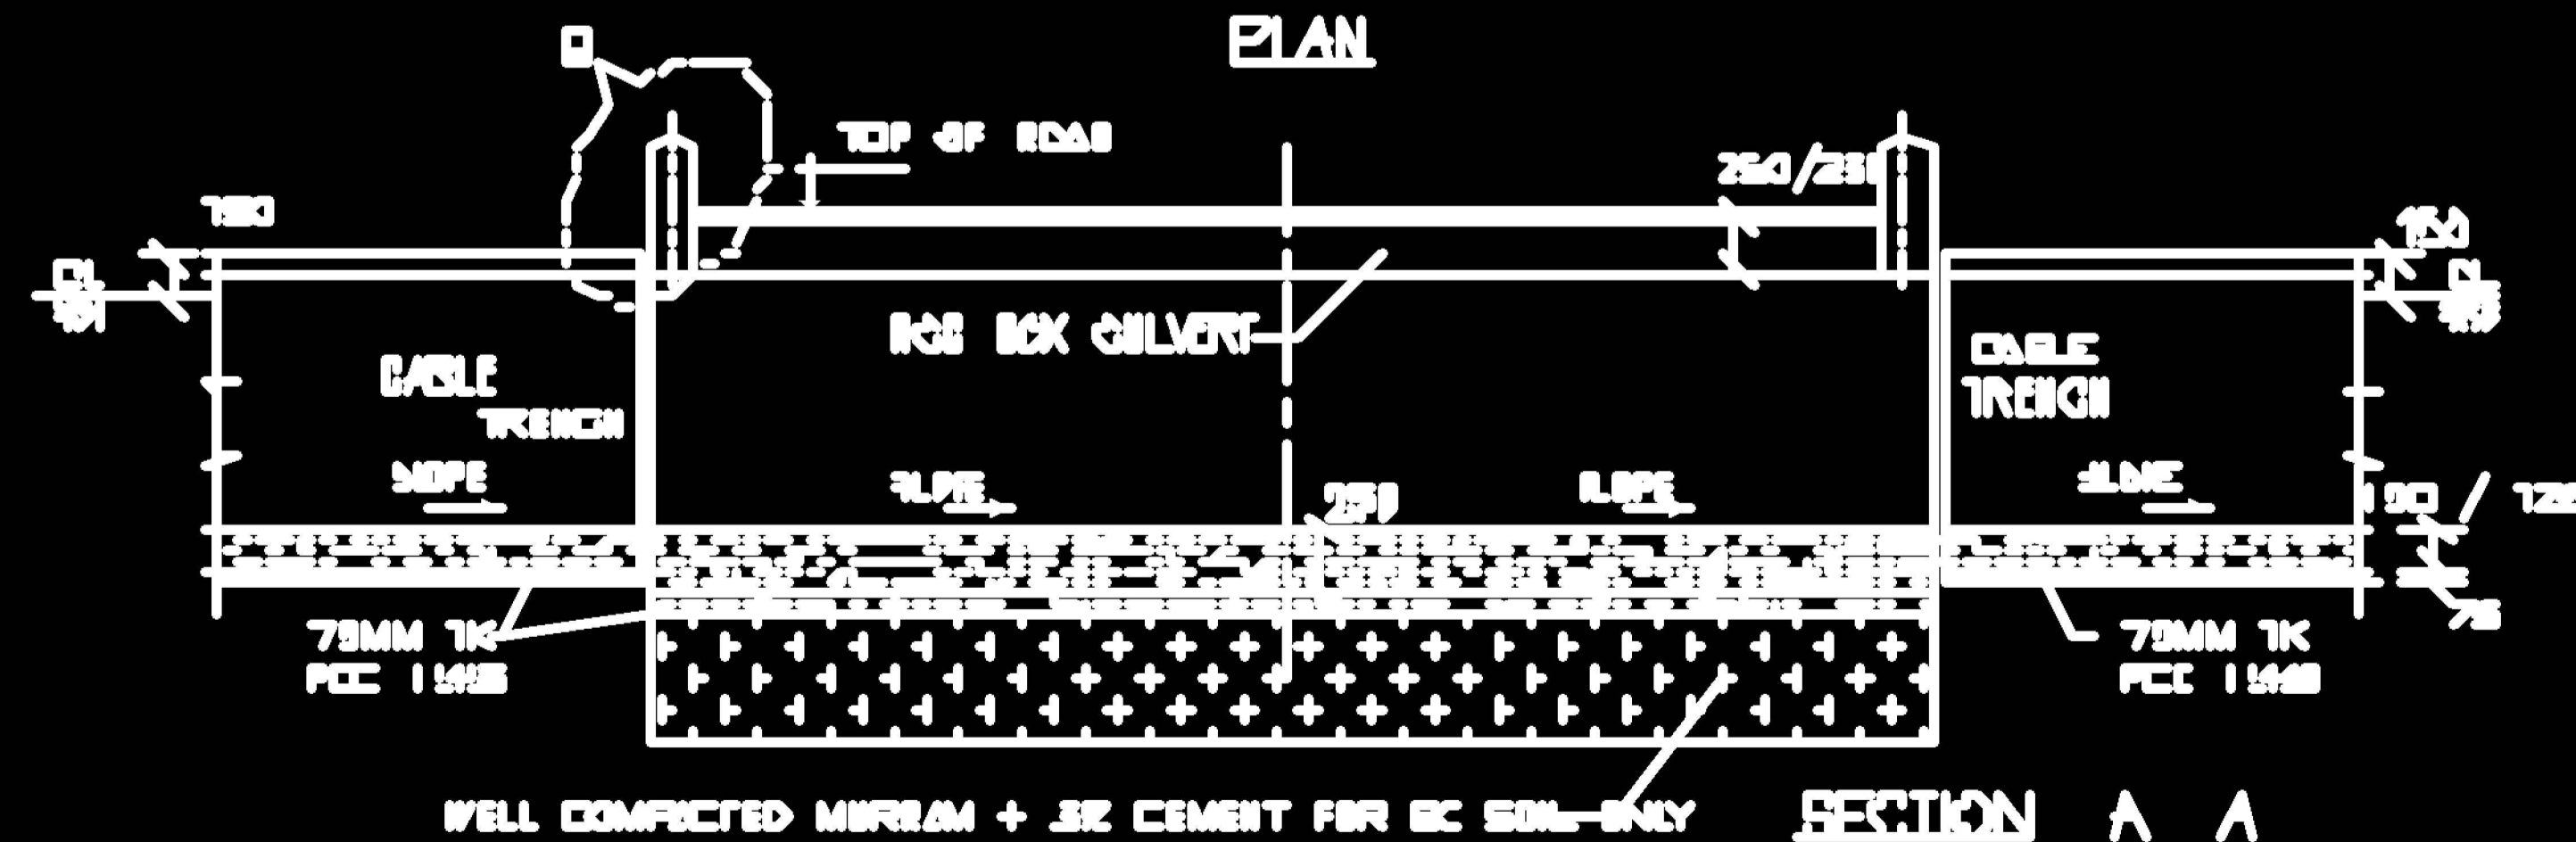

SECTION A A

- NOTES:**
1. ALL DIMENSIONS ARE IN MMS, UNLESS OTHERWISE SPECIFIED.
 2. DON'T SCALE! USE DIM. FOLLOW ONLY THE WRITTEN DIMENSIONS.
 3. ALL STRUCTURAL CONCRETE SHALL BE M20 GRADE.
 4. REINFORCEMENT SHALL BE Fe 415 GRADE.
 5. SPACING OF CLIPS: HORIZONTAL: TWICE THE WALL THICKNESS. VERTICAL: 15 DIA OF REINFORCEMENT OR 300MM WHICH EVER IS LESS.

KARNATAKA POWER TRANSMISSION CORPN LTD					
DETAILS OF CABLE TRENCH CROSSING ROAD					
DRG NO:				SCALE	
				1:50	
DESIGNED BY		CHECKED BY		DATE	
APPROVED		APPROVED		DATE	